

Dual System Sprinkler Components

Two components are required on all Dual systems; a swing connection (i.e. two inlets: one secondary inlet and one culinary inlet, and one outlet to sprinklers, all housed in the same box (Fig 1)) and a Reduced Pressure Zone Assembly with a minimum of 12" clearance between the bottom of the unit and the finished grade (Fig 2). No other type of Backflow Preventer is accepted for this application. Nor has it ever been.



Fig 1

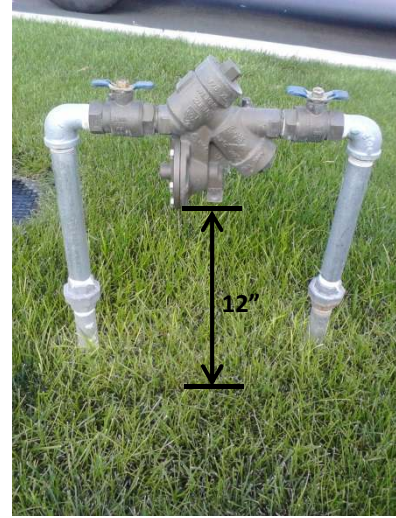


Fig 2

Dual system specs

